


Note:
Conduit, drain tubes and cap
may be galvanized steel or PVC.

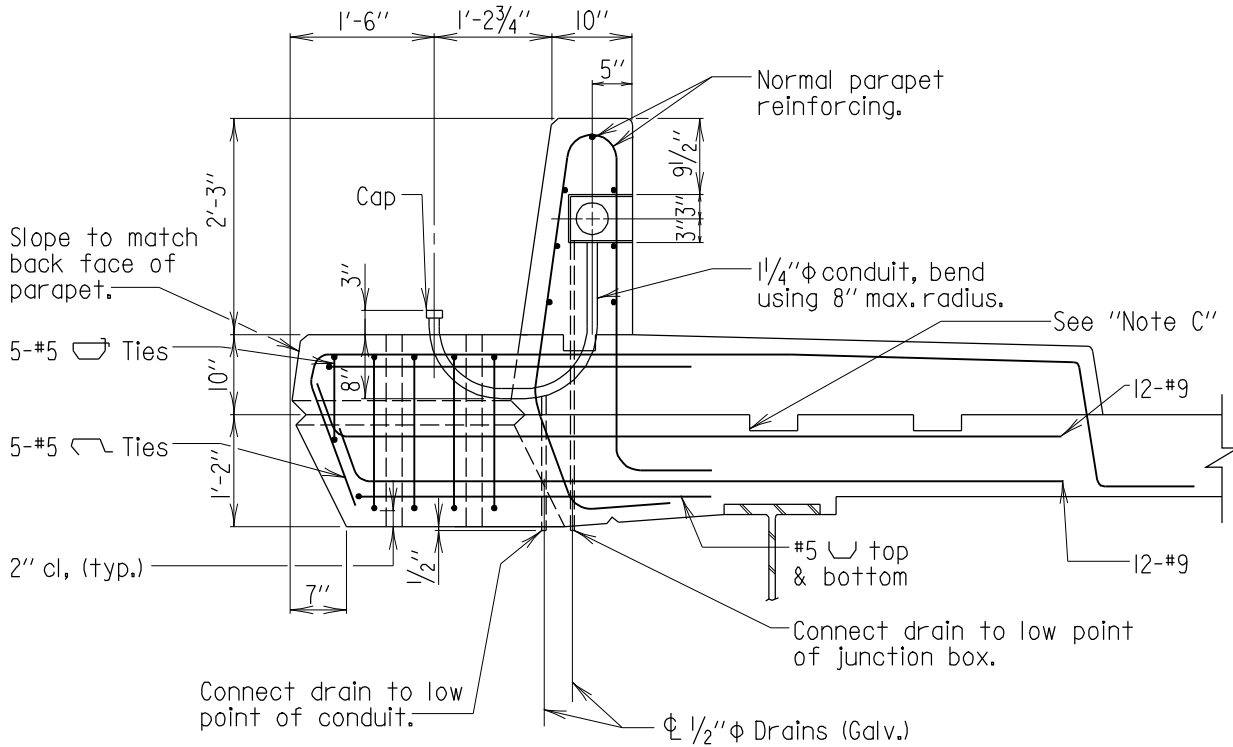

SECTION B-B FOR SIDEWALKS WITH PARAPET

Scale: 1/2" = 1'-0"

Note:

All longitudinal bars are #5's and shall be placed continuously in the sidewalk from expansion opening to expansion opening in a simple span bridge and expansion opening to centerline of pier in a multispan bridge. Refer to BR-SS(6.26)-03-161.

Note C:

The constr. jt. between the sidewalk and the deck slab may vary slightly from the joint indicated.

For exact details and location of the joint see "Superstructure" Sheet.

SIDEWALK WITH DIAMOND BACK

APPROVAL	
<i>E. S. Friedman</i>	DIRECTOR
OFFICE OF STRUCTURES	
DATE: 6/1/05	
REVISIONS	
SHA	FHWA
10-9-07	.
.	.
.	.
FHWA APPROVAL	
DATE: 3-19-85	

STATE OF MARYLAND
DEPARTMENT OF TRANSPORTATION
STATE HIGHWAY ADMINISTRATION
OFFICE OF STRUCTURES



SUPPORT BRACKET FOR MOUNTED LIGHT POST
WITH SINGLE CONDUIT AND PARAPET
WITH DIAMOND BACK AND SIDEWALK

STANDARD NO. BR-SS(6.53)-05-355(L)

SHEET 2 OF 2

SUPER-CONCRETE WORK